
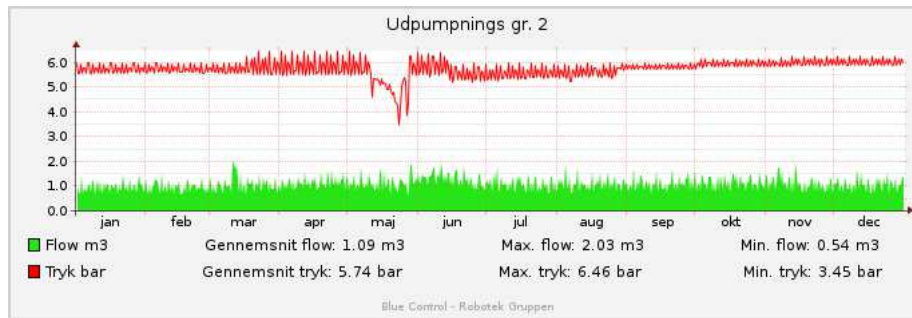


Føllenslev Vandværk

Årsrapport 2015

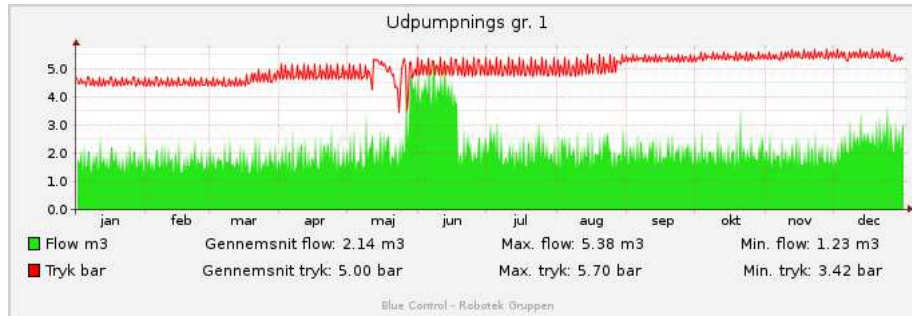

Mængder

Udpumpet vandmængde:	Total: 28.569,5 m ³	Måler 1: 18.848,4 m ³	Måler 2: 9.721,0 m ³
Indvundet vandmængde:	Total: 27.311,0 m ³		
Filter skylnig - beregnet:	448,4 m ³		

Forbrug

Elforbrug:	Total: 23.384,8 kWh	Udpumpet: 15.653,9 kWh
	Total: 0,82 kWh/m ³	Udpumpet: 0,55 kWh/m ³

Flow

Flow måler 1:

Min. Flow:	0,00 m ³ /h	Tidspunkt: 05-01-15 00:00:24
Max. Flow:	20,00 m ³ /h	Tidspunkt: 28-05-15 04:29:48

Flow måler 2:

Min. Flow:	0,00 m ³ /h	Tidspunkt: 01-01-15 00:00:00
Max. Flow:	19,61 m ³ /h	Tidspunkt: 28-05-15 04:49:45

Niveauer i boringer:

Boring 1 niveau:	Højest: -5,00 m	Lavest: -13,55 m	Sænkning: 8,55 m
Boring 2 niveau:	Højest: -1,00 m	Lavest: -11,00 m	Sænkning: 10,00 m
Boring 3 niveau:	Højest: -3,00 m	Lavest: -6,68 m	Sænkning: 3,68 m

Filter:

Filter 1:	Antal skyl:	177
Filter 2:	Antal skyl:	59

Drifttimer:

	Periode:	Total:
Boring 1:	872 Timer	1398 Timer
Boring 2:	1333 Timer	1714 Timer
Boring 3:	1593 Timer	1919 Timer
Pumpe 1:	4942 Timer	6432 Timer
Pumpe 2:	5110 Timer	6645 Timer
Pumpe 3:	2963 Timer	4031 Timer
Pumpe 4:	2970 Timer	4076 Timer
Pumpe 5:	2865 Timer	3706 Timer